


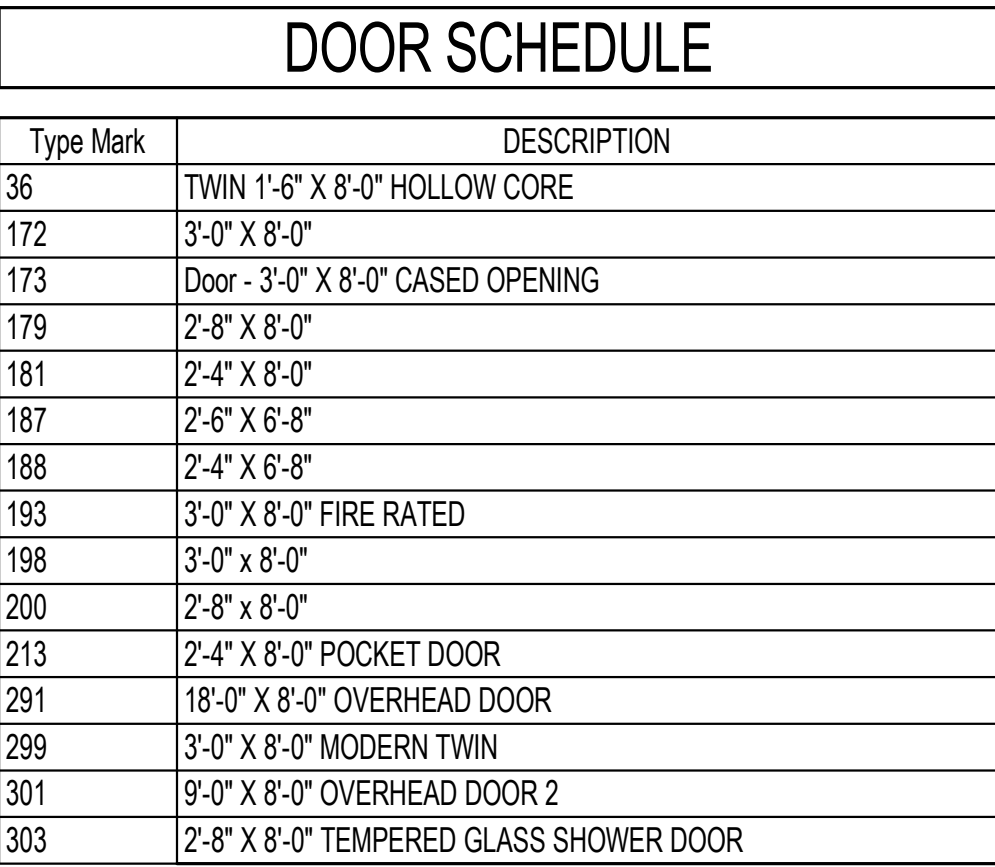


NOTE: ALWAYS REFER TO ELEVATIONS WHEN ORDERING WINDOWS AND DOORS

TYPE MARK	WIDTH	HEIGHT	SILL HEIGHT	OPERATION	UNIT	TYPE	QTY
B1	3'-0"	5'-0"	2'-0"	SINGLE HUNG	SINGLE	DIVIDED LITE	6
B2	3'-0"	6'-0"	2'-0"	SINGLE HUNG	SINGLE	DIVIDED LITE	2
B8	2'-0"	4'-0"	4'-0"	SINGLE HUNG	SINGLE	DIVIDED LITE	2
B16	2'-8"	6'-0"	2'-0"	SINGLE HUNG	SINGLE	DIVIDED LITE	2
D9	3'-0"	1'-6"	6'-6"	FIXED	SINGLE	DIVIDED LITE	2
D10	3'-0"	8'-0"	0"	FIXED	SINGLE	DIVIDED LITE	4
F2	3'-0"	6'-0"	2'-0"	SINGLE HUNG	TWIN	DIVIDED LITE	5
H4	3'-0"	4'-0"	3'-0"	FIXED	TWIN	DIVIDED LITE	1
H7			8'-0"	FIXED	TWIN	DIVIDED LITE MULL TO UNIT BELOW	4
	3'-0"	3'-0"					
H10	3'-0"	6'-0"	2'-0"	SINGLE HUNG	TRIPLE	DIVIDED LITE	1
H115	3'-0"	4'-0"	13'-4"	FIXED	TRIPLE	DIVIDED LITE	2
H273	3'-0"	1'-6"	6'-6"	FIXED	TWIN	DIVIDED LITE	1


LOCATION:	SQ. FT.
1ST FLOOR LIVING:	2,877 SF
BACK PORCH:	211 SF
BRICK POCKET:	60 SF
FRONT PORCH:	117 SF
GARAGE:	927 SF
*TOTAL SLAB:	4,192 SF

LOCATION:	SQ. FT.
1ST FLOOR LIVING:	2,877 SF
BONUS ROOM:	567 SF
TOTAL LIVING:	3,444 SF




1. A.C. VENTS IN MASTER CLOSET.
2. ALL SMOKE DETECTORS SHALL BE HARDWIRED.
3. ALL WORK SHALL BE IN STRICT COMPLIANCE WITH CITY OR COUNTY BUILDING CODES AND ORDINANCES.
4. GENERAL & SUBCONTRACTORS SHALL VERIFY DIMENSIONS AND EXISTING SITE CONDITIONS. STARTING OF WORK SHALL MEAN ACCEPTANCE OF SUCH CONDITIONS.
5. LOCATION OF STORM SEWAGE, DRAINAGE, EASEMENTS, AND BUILDING SETBACKS VERIFIED AT JOB SITE PRIOR TO CONSTRUCTION.
6. ALL DIMENSIONS ON EXTERIOR WALLS ARE FROM OUTSIDE OF FOUNDATION TO FACE OF STUD OR FACE OF MASONRY TO FACE OF STUD.
7. ALL DIMENSIONS ON INTERIOR WALLS ARE FROM FACE OF STUD TO FACE OF STUD.
8. ALL DIMENSIONS TO OPENINGS ARE FROM FOUNDATION TO CENTER OF OPENING.
9. ALL EXHAUST FANS IN WET AREAS SHALL BE VENTED OUTSIDE THE HOUSE.
10. ALL WORK TO CONFORM TO DEED RESTRICTIONS IF APPLICABLE.
11. PLANS TO BE REVIEWED BE ARCHITECTURAL CONTROL COMMITTEE.
12. IF A/C IS IN ATTIC, A 3/4" PLYWOOD CATWALK SHALL GO FROM ACCESS HOLE TO UNIT, AND UNIT MUST BE WITHIN 20'
13. GENERAL AND SUBCONTRACTORS SHALL VERIFY ENGINEERED DRAWINGS AND ARCHITECTURAL DRAWINGS DO NOT HAVE DISCREPANCIES.
14. LOCATION OF STORM DRAINAGE, EASEMENTS, AND BUILDING SETBACKS SHALL BE VERIFIED AT JOB SITE PRIOR TO CONSTRUCTION.
15. ALL WINDOWS WITHIN 24" OF AN EXTERIOR OR INTERIOR DOOR TO BE TEMPERED GLASS. ALL OTHER TEMPERED GLASS LOCATIONS PER CODES
16. GENERAL AND SUBCONTRACTORS TO VERIFY ALL WINDOWS MEET EGRESS CODES IN APPLICABLE LOCATIONS.
17. GENERAL AND SUBCONTRACTORS TO VERIFY SIZING AND LOCATIONS OF ALL APPLIANCES AND COMPONENTS.



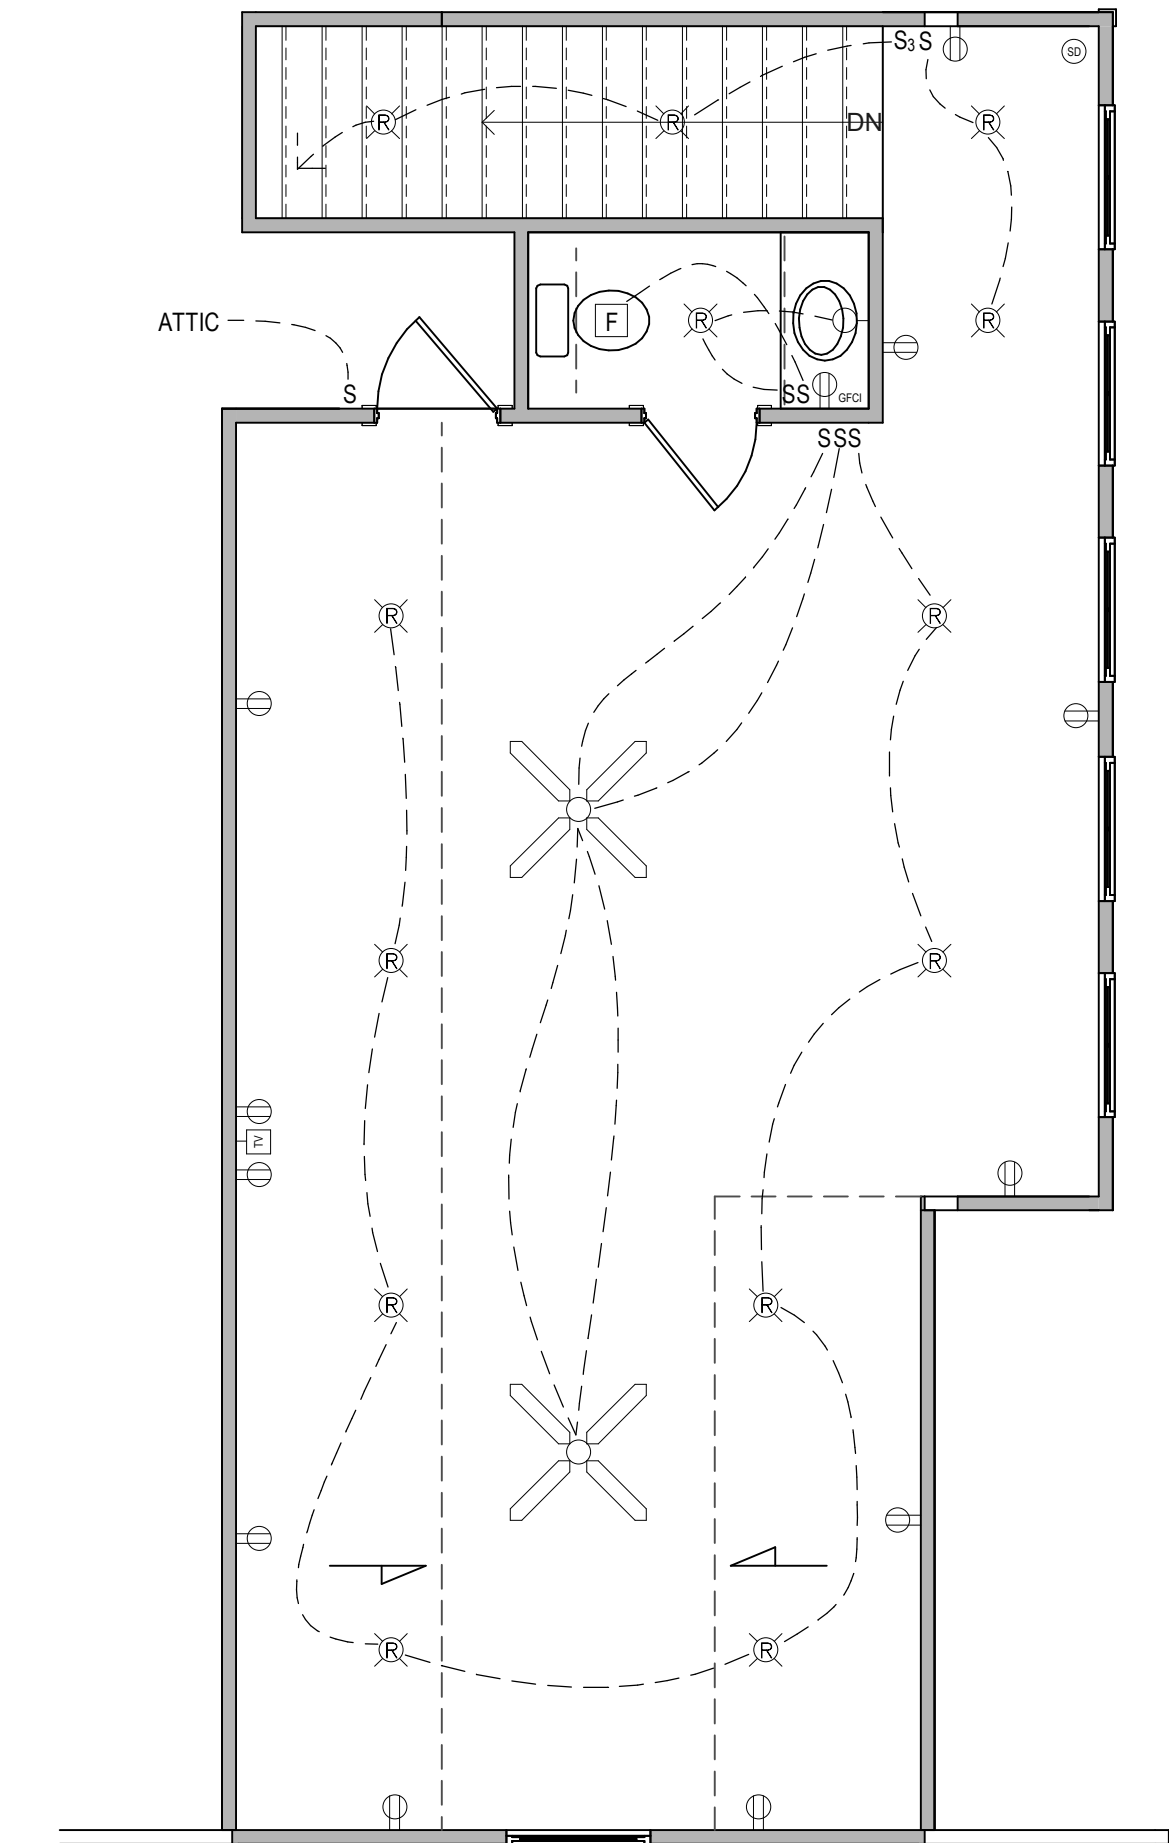

2 2ND FLOOR ELECTRICAL
1/4" = 1'-0"

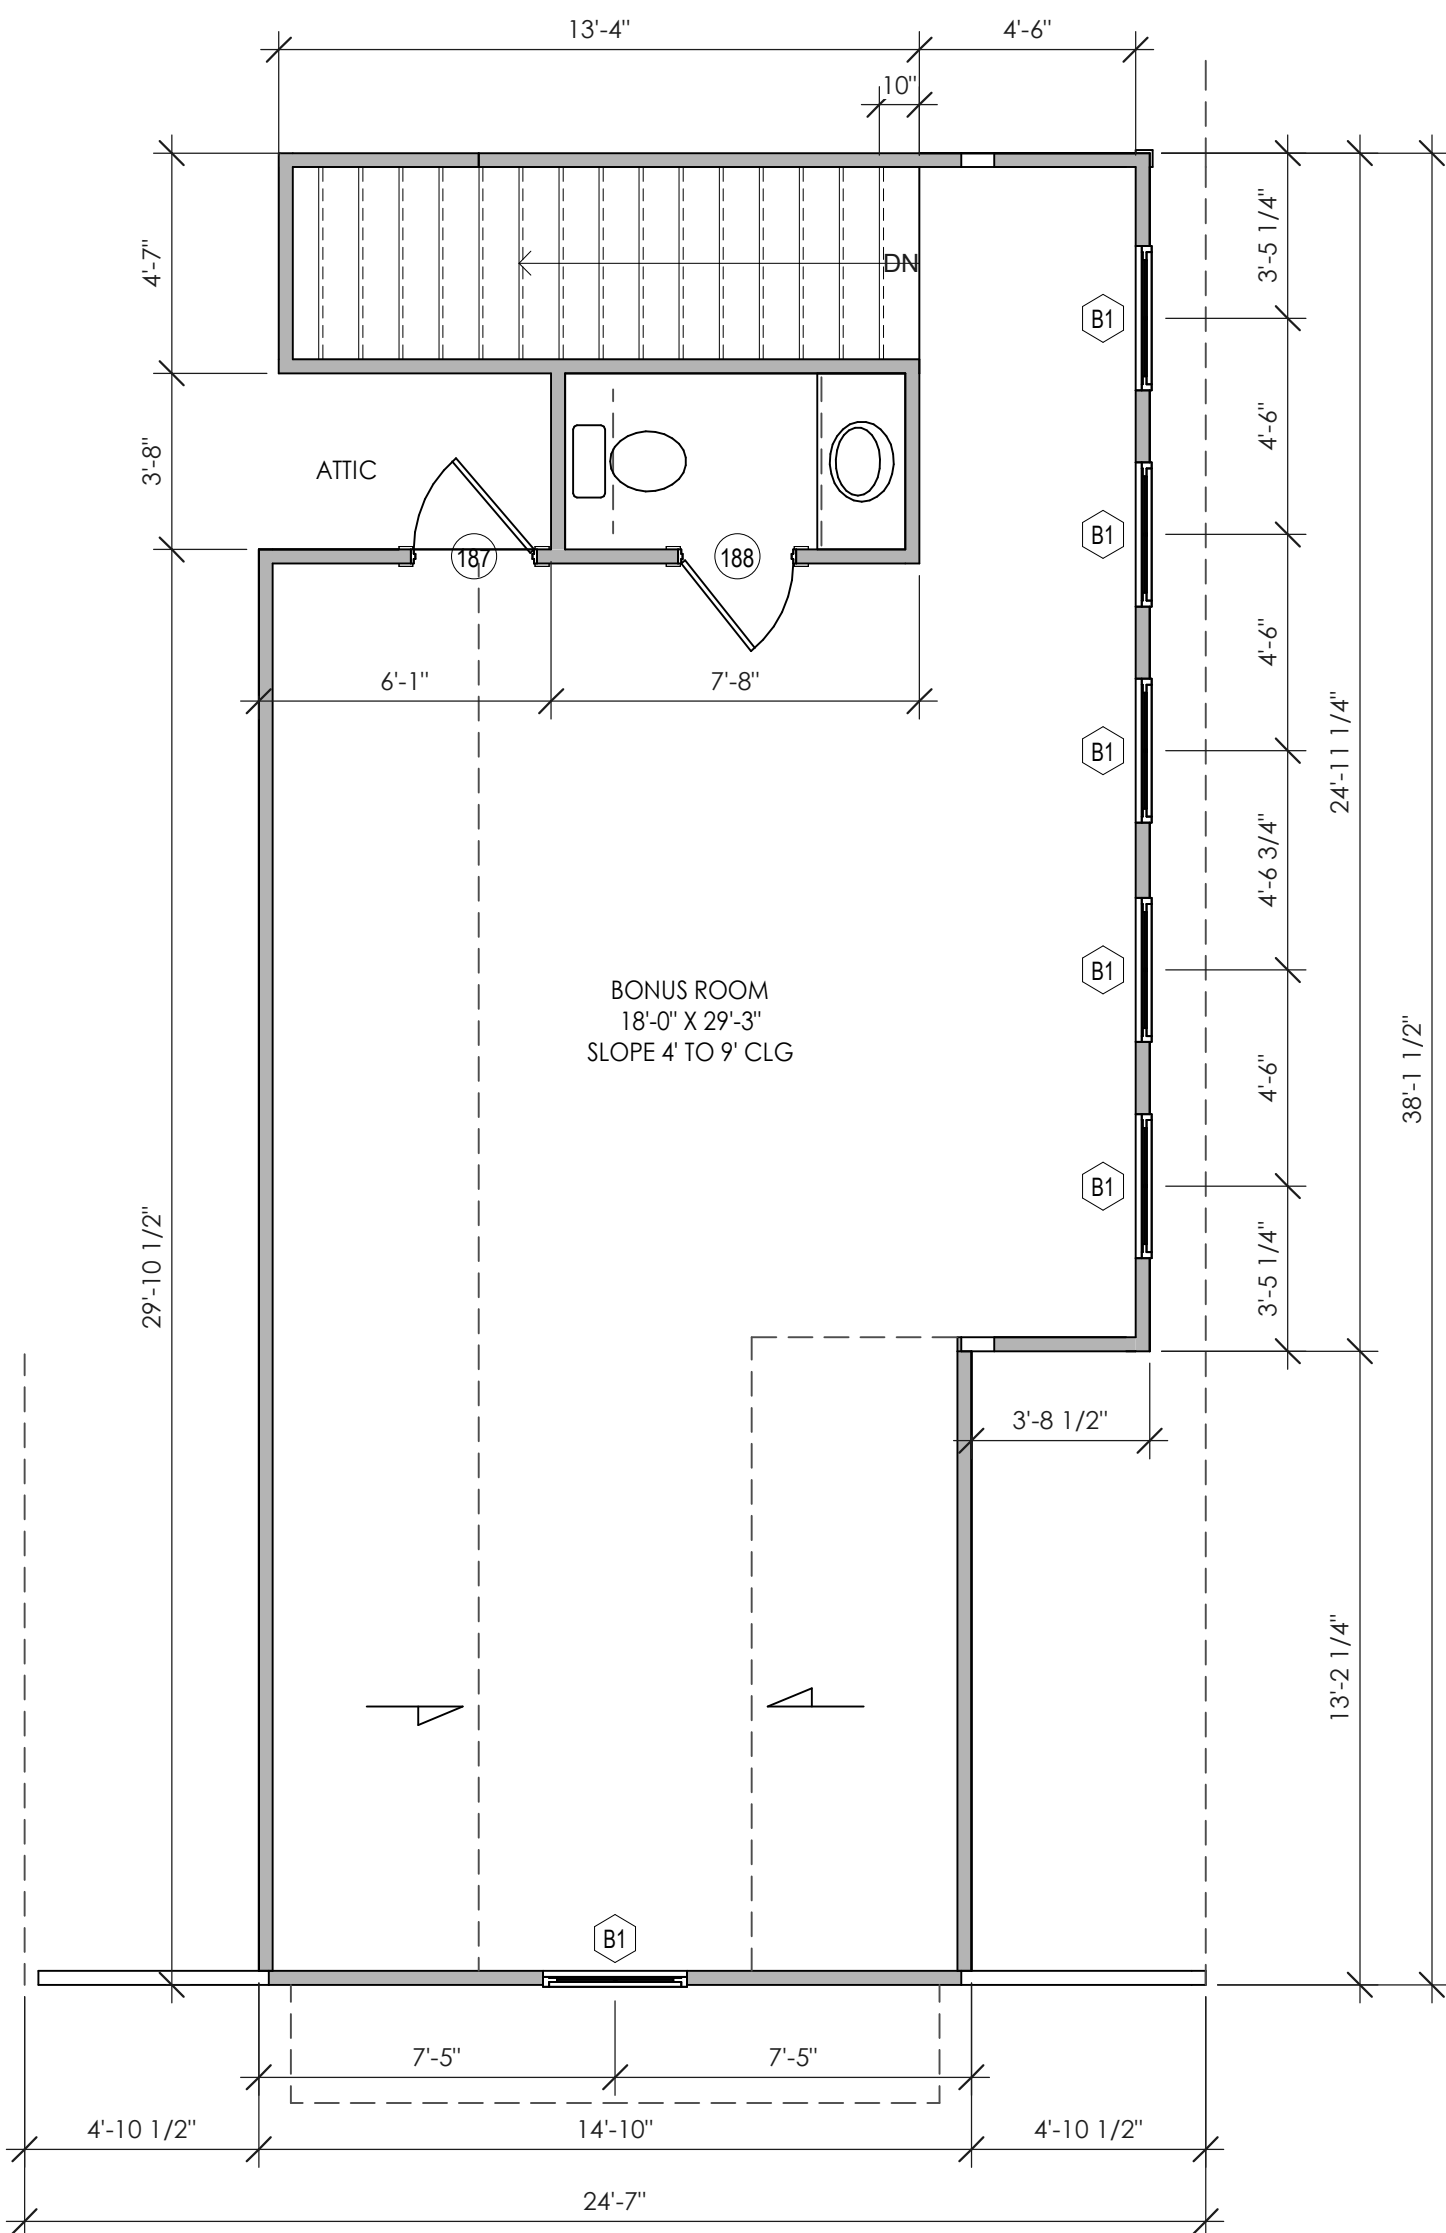

1 2ND FLOOR
1/4" = 1'-0"

DOOR SCHEDULE

Type Mark	DESCRIPTION
36	TWIN 1'-6" X 8'-0" HOLLOW CORE
172	3'-0" X 8'-0"
173	Door - 3'-0" X 8'-0" CASSED OPENING
179	2'-8" X 8'-0"
181	2'-4" X 8'-0"
187	2'-6" X 6'-8"
188	2'-4" X 6'-8"
193	3'-0" X 8'-0" FIRE RATED
198	3'-0" x 8'-0"
200	2'-8" x 8'-0"
213	2'-4" X 8'-0" POCKET DOOR
291	18'-0" X 8'-0" OVERHEAD DOOR
299	3'-0" X 8'-0" MODERN TWIN
301	9'-0" X 8'-0" OVERHEAD DOOR 2
303	2'-8" X 8'-0" TEMPERED GLASS SHOWER DOOR

WINDOW SCHEDULE

TYPE MARK	WIDTH	HEIGHT	SILL HEIGHT	OPERATION	UNIT	TYPE	QTY
B1	3'-0"	5'-0"	2'-0"	SINGLE HUNG	SINGLE	DIVIDED LITE	6
B2	3'-0"	6'-0"	2'-0"	SINGLE HUNG	SINGLE	DIVIDED LITE	2
B8	2'-0"	4'-0"	4'-0"	SINGLE HUNG	SINGLE	DIVIDED LITE	2
B16	2'-8"	6'-0"	2'-0"	SINGLE HUNG	SINGLE	DIVIDED LITE	2
D9	3'-0"	1'-6"	6'-6"	FIXED	SINGLE	DIVIDED LITE	2
D10	3'-0"	8'-0"	0"	FIXED	SINGLE	DIVIDED LITE	4
F2	3'-0"	6'-0"	2'-0"	SINGLE HUNG	TWIN	DIVIDED LITE	5
H4	3'-0"	4'-0"	3'-0"	FIXED	TWIN	DIVIDED LITE	1
H7	3'-0"	3'-0"	8'-0"	FIXED	TWIN	DIVIDED LITE MULL TO UNIT BELOW	4
H102	3'-0"	6'-0"	2'-0"	SINGLE HUNG	TRIPLE	DIVIDED LITE	1
H115	3'-0"	4'-0"	13'-4"	FIXED	TRIPLE	DIVIDED LITE	2
H273	3'-0"	1'-6"	6'-6"	FIXED	TWIN	DIVIDED LITE	1

TOTAL PROJECT WINDOWS: 32

AREA SLAB

LOCATION:	SQ. FT.
1ST FLOOR LIVING:	2,877 SF
BACK PORCH:	211 SF
BRICK POCKET:	60 SF
FRONT PORCH:	117 SF
GARAGE:	327 SF
*TOTAL SLAB:	4,192 SF

AREA LIVING

LOCATION:	SQ. FT.
1ST FLOOR LIVING:	2,877 SF
BONUS ROOM:	567 SF
TOTAL LIVING:	3,444 SF

0 2 4
SCALE: 1/4" = 1'-0"

GENERAL NOTES:

- A.C. VENTS IN MASTER CLOSET.
- ALL SMOKE DETECTORS SHALL BE HARDWIRED.
- ALL WORK SHALL BE IN STRICT ACCORDANCE WITH CITY OR COUNTY BUILDING CODES AND ORDINANCES.
- GENERAL & SUBCONTRACTORS SHALL VERIFY DIMENSIONS AND EXISTING SITE CONDITIONS. STARTING OF WORK SHALL MEAN ACCEPTANCE OF SUCH CONDITIONS.
- LOCATION OF STORM SEWAGE, DRAINAGE, EASEMENTS, AND BUILDING SETBACKS VERIFIED AT JOB SITE PRIOR TO CONSTRUCTION.
- ALL DIMENSIONS ON EXTERIOR WALLS ARE FROM OUTSIDE OF FOUNDATION TO FACE OF STUD OR FACE OF MASONRY TO FACE OF STUD.
- ALL DIMENSIONS ON INTERIOR WALLS ARE FROM FACE OF STUD TO FACE OF STUD.
- ALL DIMENSIONS TO OPENINGS ARE FROM FOUNDATION TO CENTER OF OPENING.
- ALL EXHAUST FANS IN WET AREAS SHALL BE VENTED OUTSIDE THE HOUSE.
- ALL WORK TO CONFORM TO DEED RESTRICTIONS IF APPLICABLE. PLANS TO BE REVIEWED BE ARCHITECTURAL CONTROL COMMITTEE.
- IF A/C IS IN ATTIC, A 3/4" PLYWOOD CATWALK SHALL GO FROM ACCESS HOLE TO UNIT, AND UNIT MUST BE WITHIN 20'
- GENERAL AND SUBCONTRACTORS SHALL VERIFY ENGINEERED DRAWINGS AND ARCHITECTURAL DRAWINGS DO NOT HAVE DISCREPANCIES.
- LOCATION OF STORM DRAINAGE, EASEMENTS, AND BUILDING SETBACKS SHALL BE VERIFIED AT JOB SITE PRIOR TO CONSTRUCTION.
- ALL WINDOWS WITHIN 24" OF AN EXTERIOR OR INTERIOR DOOR TO BE TEMPERED GLASS. ALL OTHER TEMPERED GLASS LOCATIONS PER CODES
- GENERAL AND SUBCONTRACTORS TO VERIFY ALL WINDOWS MEET EGRESS CODES IN APPLICABLE LOCATIONS.
- GENERAL AND SUBCONTRACTORS TO VERIFY SIZING AND LOCATIONS OF ALL APPLIANCES AND COMPONENTS.

