Wisconsin Department of Commerce
Safety and Buildings Division

PRIVATE SEWAGE SYSTEM INSPECTION REPORT
(ATTACH TO PERMIT)

County:	SHEBOYGAN
Sanitary Permit No.:	321240 / # 6739 ooy.
State Plan ID No.:	–
Parcel Tax No.:	# 267815 T9-32-HIQUIT.14

GENERAL INFORMATION

Personal information you provice may be used for secondary purposes [Privacy Law, s.15.04 (1)(m)].

Permit Holder's Name: PAT EBERT N7628 Royal & Ancient Dr.	☐ City ☐ Village ☒ Town of: RHINE	
CST BM Elev.: 100.00	Insp. BM Elev.: 100.00	BM Description: Top of Telephone Ped # 2298

TANK INFORMATION

TYPE	MANUFACTURER	CAPACITY
Septic	LEDGEVIEW COMBO	1000/500
Dosing	ZABEL A-100 FILTER AS	
Aeration	OUTLET BAFFLE ON 2ND	
Holding	SEPTIC TANK COMPARTMENT	

TANK SETBACK INFORMATION

TANK TO	P/L	WELL	BLDG.	Vent to Air Intake	ROAD
Septic	62'± EPL	*	5'	19'	NA
Dosing					NA
Aeration					NA
Holding					

PUMP / SIPHON INFORMATION N/A

Manufacturer				Demand	
Model Number				GPM	
TDH	Lift	Friction Loss	System Head	TDH	Ft
Forcemain	Length	Dia.	Dist. To Well		

ELEVATION DATA

STATION	BS	HI	FS	ELEV.
Benchmark 10/15	11.00			100.00
bottom siding (BM #2)		111.00	3.05	107.95
Bldg. Sewer		110.47	4.00	106.47
St/Ht Inlet		110.47	4.55	105.92
St/Ht Outlet		110.47	4.92	105.55
Dt Inlet		–	–	–
Dt Bottom		–	–	–
Header / Man.		–	–	–
Dist. Pipe		110.47	6.04	104.43
Bot. System		110.47	6.95	103.52
Final Grade		110.47	4.90	105.57
BM #2	2.52			107.95
d-box inlet		110.47	5.74	104.73
d-box outlet		110.47	5.89	104.58
Top stone		110.47	5.72	105.27

SOIL ABSORPTION SYSTEM

BED / TRENCH DIMENSIONS	Width 15'	Length 60'	No. Of Trenches –	PIT DIMENSIONS	No. Of Pits	Inside Dia.	Liquid Depth
SETBACK INFORMATION	SYSTEM TO	P/L	BLDG	WELL	LAKE / STREAM	LEACHING CHAMBER OR UNIT	Manufacturer:
	Type Of System: CONV.	40'± EPL	17' porch 25' res.	*	N/A		Model Number:

DISTRIBUTION SYSTEM

Header / Manifold Dist. Box + SDR 35 Length ____ Dia. 4" SEE DRAWING	Distribution Pipe(s) 3 ASTM D2729 Length 54' Dia. 4" Spacing 4½' o.c.	x Hole Size –	x Hole Spacing –	Vent To Air Intake 37'±

SOIL COVER

x Pressure Systems Only xx Mound Or At-Grade Systems Only

Depth Over Bed / Trench Center	Depth Over Bed / Trench Edges	xx Depth Of Topsoil –	xx Seeded / Sodded ☐ Yes ☐ No N/A	xx Mulched ☐ Yes ☐ No N/A

COMMENTS: (Include code discrepancies, persons present, etc.)

10-15-98 MM & KS on-site w/ J. Hand (MP 223582); obs. bldg. SEWER, TANK, EFFLUENT LINE, DIST. SYSTEM. REVISION REC'D ON-SITE FROM INSTALLER

* No Well @ inspection *

Plan revision required? ☒ Yes ☐ No
Use other side for additional information.

Date	Inspector's Signature	Cert. No.
10 15 98	Matthew Mackinl LA	224857

SBD-6710 (R.3/97)

ADDITIONAL COMMENTS AND SKETCH

SANITARY PERMIT NUMBER: # 6739 CTY.

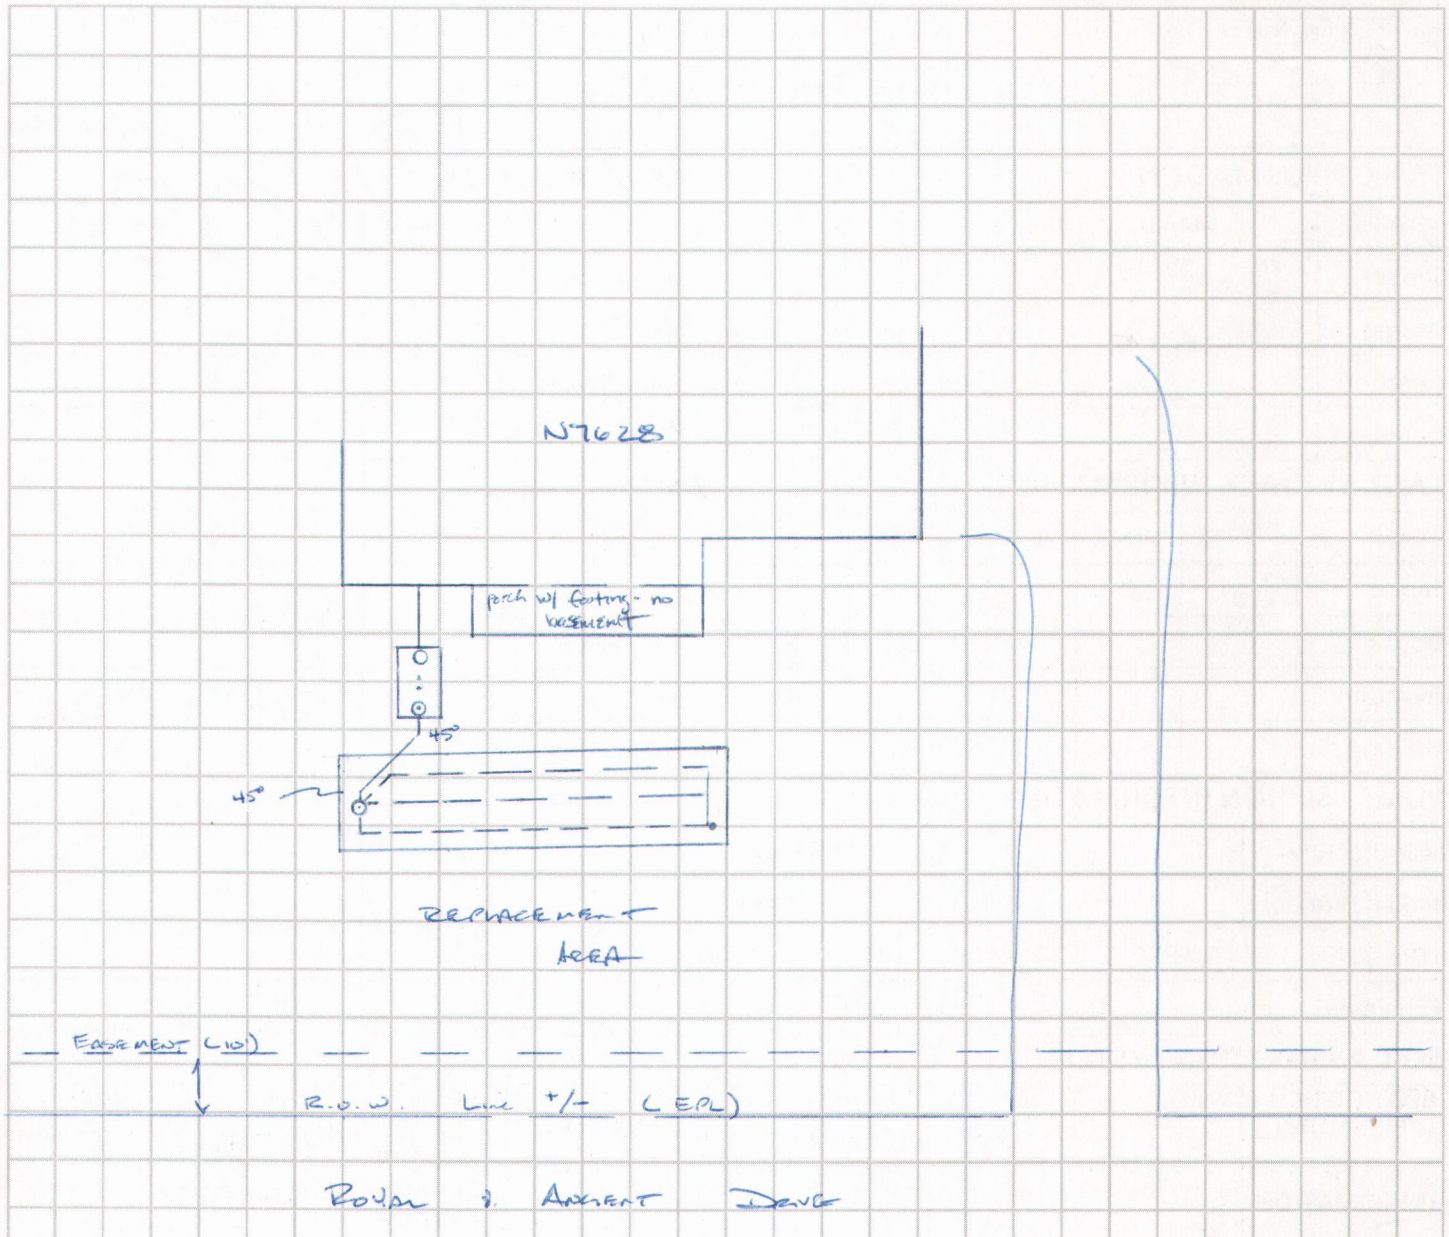

- All SCH 40 bldg sewer & effluent line
- 3/4" STONE BEDDING
- ZABEL A-100 as outlet baffle on second septic tank compartment
- 12" riser on ea. S.T. manhole
- headers are solid wall SDR 35

SCALE 1" : 30'