Industry Services Division

PRIVATE ONSITE WASTE TREATMENT SYSTEMS (POWTS) INSPECTION REPORT

(ATTACH TO PERMIT)

County
Sheboygan
Sanitary Permit No: Co. 9648 State 578649
State Plan Transaction ID#: 2506372
Parcel Tax No: 59026389790 T13 30 2.23

GENERAL INFORMATION

Personal information you provide may be used for secondary purposes [Privacy Law, s. 15.04 (1)(m)]

Permit Holder's Name:	☐ City ☐ Village ■ Town of:		
Mark Schuller	Sheboygan Falls		
CST BM Elev: 100.00'	Insp BM Elev: 100.00'	BM Description: Top of Concrete	

TANK INFORMATION

TYPE	MANUFACTURER	CAPACITY
Septic	Ledgeview	1650 gallons Three Compartments
Dosing		
		(Sludgehammer S-46)

TANK SETBACK INFORMATION

TANK TO	P/L	WELL	BLDG	VENT TO AIR INTAKE	ROAD
Septic	87'	78'	14'	16'	NA
Dosing					NA

PUMP / SIPHON INFORMATION

Manufacturer	Goulds		27 GPM
Model Number	PE41		
Lift 8.30'	Fric. Loss .82'	System Head 3.25'	12.37' TDH
Forcemain	Length 51'	Dia. 2"	Dist. To Well 84'

ELEVATION DATA

STATION	BS	HI	FS	ELEV
Benchmark #1	6.51'	106.51'		100.00'
Bldg. Sewer (24' from house)		106.51'	7.65'	98.86'
ST Inlet		106.51'	9.88'	96.63'
Top of Block		106.51'	13.44'	93.07'
Manifold		106.51'	5.14'	101.37'
Laterals		106.51'	5.20'	101.31'
System Elev.		106.51'	5.87'	100.64'
Top of Stone		106.51'	4.99'	101.52'
Final Grade		106.51'	3.99'	102.52'

DISPERSAL CELL INFORMATION

DIMENSIONS	Width 4'	Length 50'	No of Cells 1	
SETBACK INFORMATION	P / L	Bldg	Well	OHWM of Nav Waters
CELL TO	21'	17'	82'	N/A

Type of System		Manufacturer:
Pre-treatment Mound	LEACHING CHAMBER	Model Number:

DISTRIBUTION SYSTEM

X Pressure Systems Only

Header / Manifold	Distribution Pipe(s)	X Hole Size	X Hole Spacing	Observation Pipes
Length 2' Dia 2"	Length 23.75' Dia 1" Space 2'	3/16"	30"	■ Yes ☐ No

SOIL COVER

Depth Over Cell Center 12" Minimum	Depth Over Cell Edges 12" Minimum	Depth of Topsoil 6" Minimum	Seeded / Sodded	Mulched
			■Yes ☐ No	■Yes ☐ No

COMMENTS: (Include code discrepancies, persons present, etc.) TYPE OF FILTER USED Polylok PL525

7-28-15: KF shot grade elevations and checked soil moisture with Rod Dirkse. Soil dry.
9-1-15: KF inspected system installation with Barry Huibregtse.

Plan revision required? ☐ Yes ■No

Use other side for additional information

09	01	15

Date

Kathryn Fabian

POWTS Inspector's Signature

1	0	9	3	6	8	7

Cert No

12' north of inside corner, 1' sch 40 exits house to 45° down to 18" sch 40 to 45° flat to 26' sch 40 to 45° to 17' sch 40 to 45° to 6' sch 40 into Ledgeview 1650 gallon three compartment tank with 3' risers on each manhole, Sludgehammer S-46 unit in first compartment, Polylok PL525 filter and Goulds PE41 pump. Last 24' of building sewer insulated. 4' fm in 4" sleeve exits tank to 15' fm to 90° up to 3' fm to 90° flat to 28' fm to 90° to 1' fm to manifold. Observation wells 7' from each end of cell. Owner to seed and mulch. Old tank pumped by ECPI and abandoned by installer.

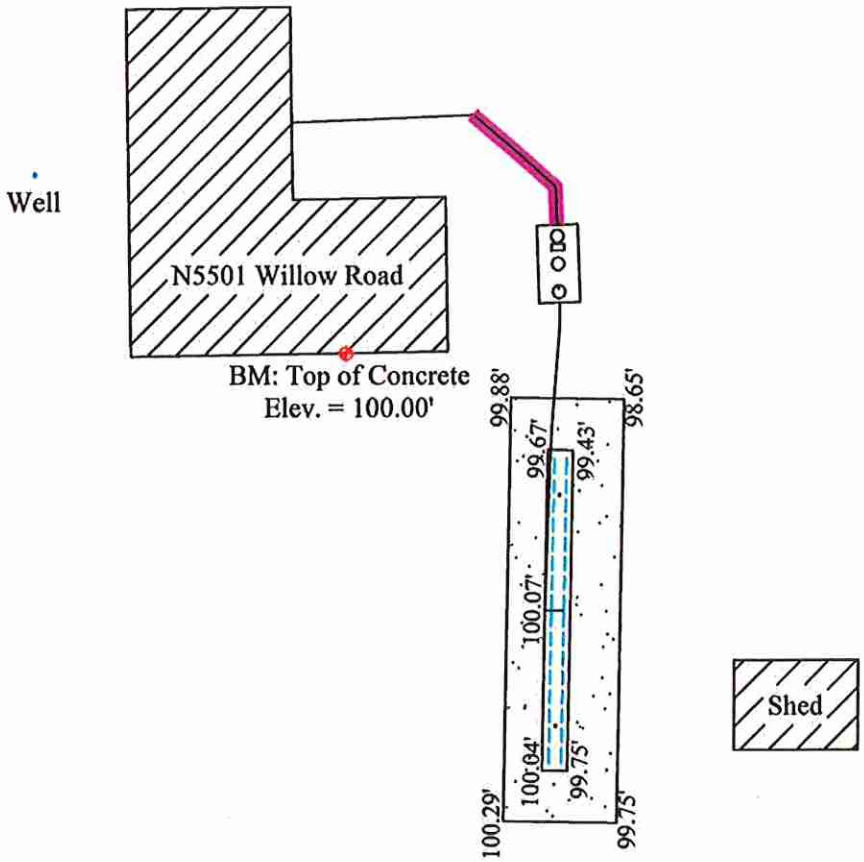

NORTH
Scale: 1" = 30'
Sanitary Permit #9648

0460

SC 1172 Private Sewage Disposal Installation Sheet of Detailed Specifications and Installer's Cerification.

Shall be completed by authorized county inspector, by owner, or by installer, and shall be filed and kept available in the Sheboygan County Planning and Resources Department.

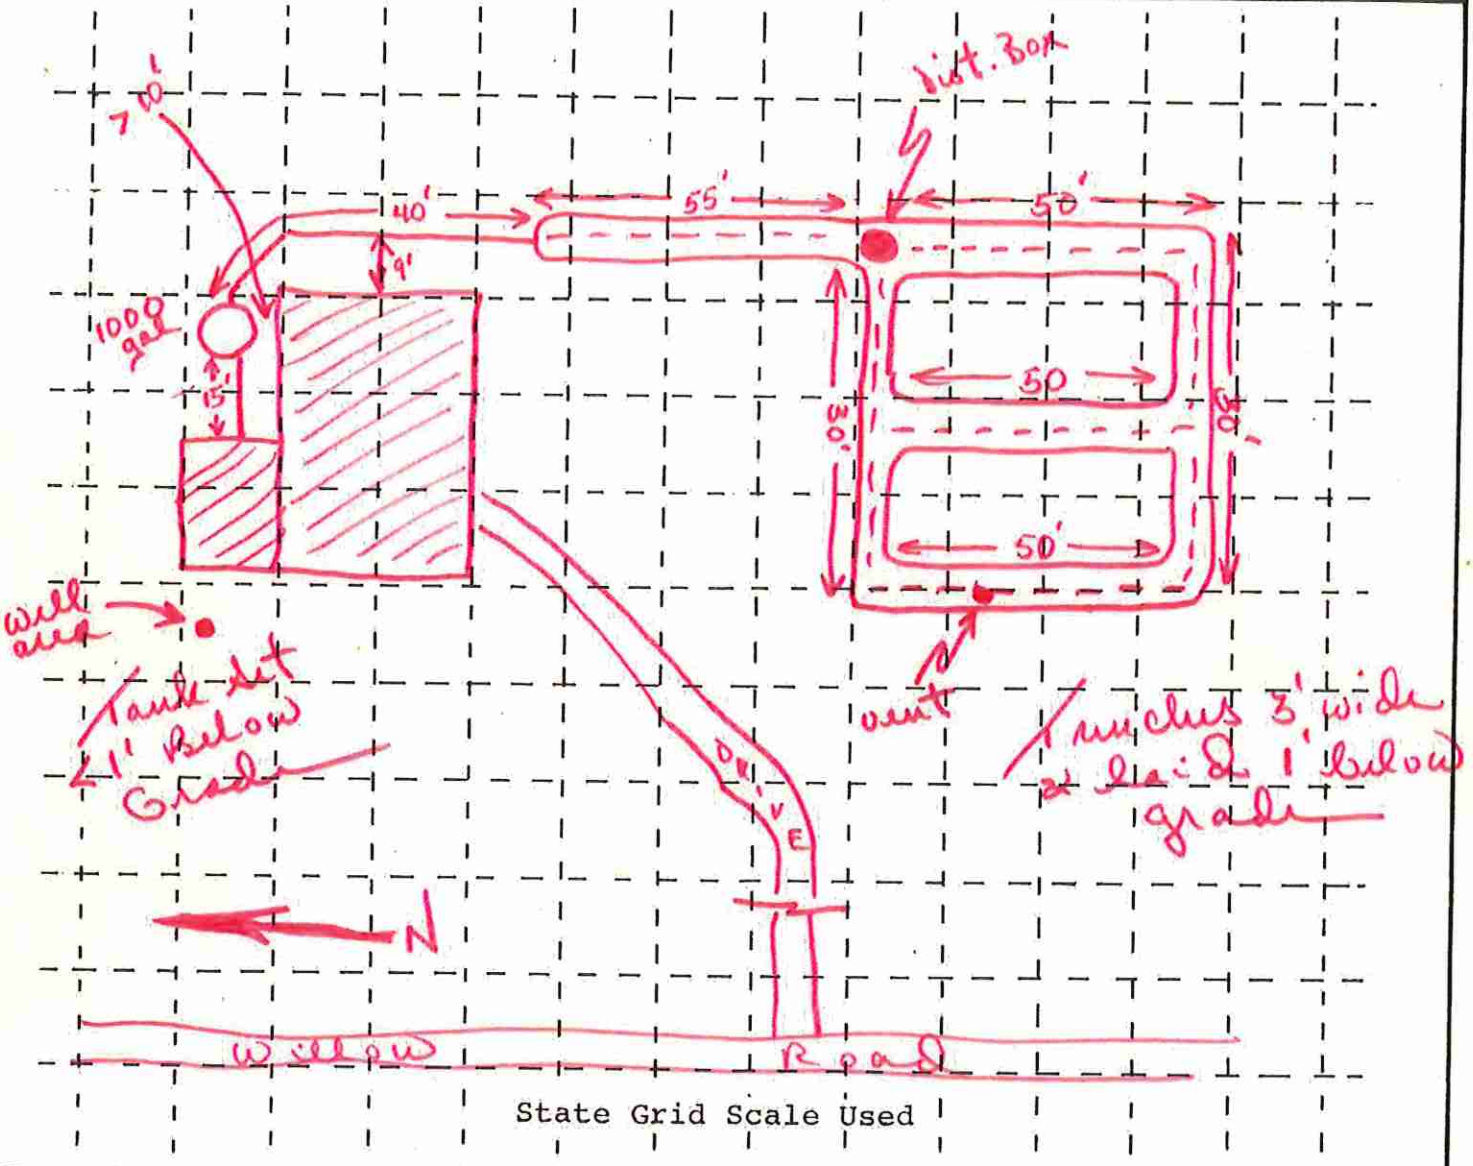

State Grid Scale Used

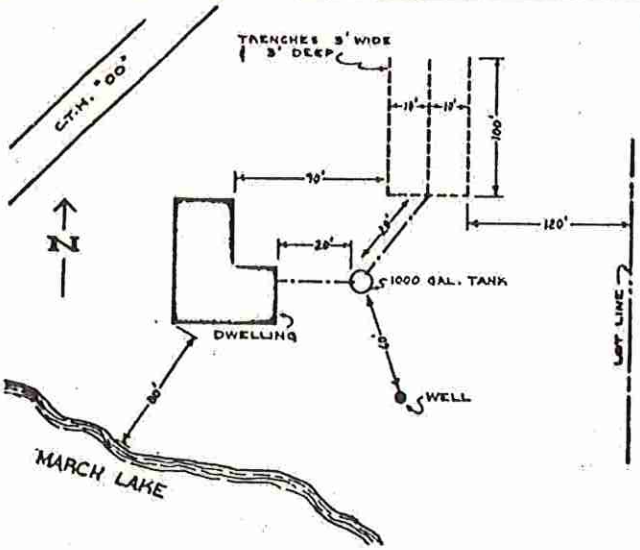

As in Example, please indicate detailed specs on disposal system, and distances from main structures to septic tank & filter bed, and from tank & system to near lot line(s) well(s), and any surface waters.

Date... 8-7-74

Signature of Installer... Dan Mueller

Signature of Inspector, Owner, or other witness... [illegible]

Township... Sub. Falls ...Section... 30