


NOTES TO FOLLOW:

- A. Minimum communications cabling requirement – Single 1" conduit from outside demarcation point to inside home run location, and a single 1" conduit or CAT5/RG6 from inside home run location to entertainment area. If you choose to run CAT5/RG6 to other locations throughout the home, then both shall be run to the location.
- B. Smoke alarms shall be installed per R314.3. All smoke alarms shall be located completely in top 12" of tray ceilings, min. 36" from doorways to bathrooms with tub or shower and Min 36" from tips of ceiling fan blades. On sloped ceiling alarms need to be located within 36" horizontally of peak or high side of ceiling but not in top 4".
- C. Water service lines ¼ inch to 2 inch will require the installation AY McDonald 76107MW locking valves on all supply side of the meter sets.

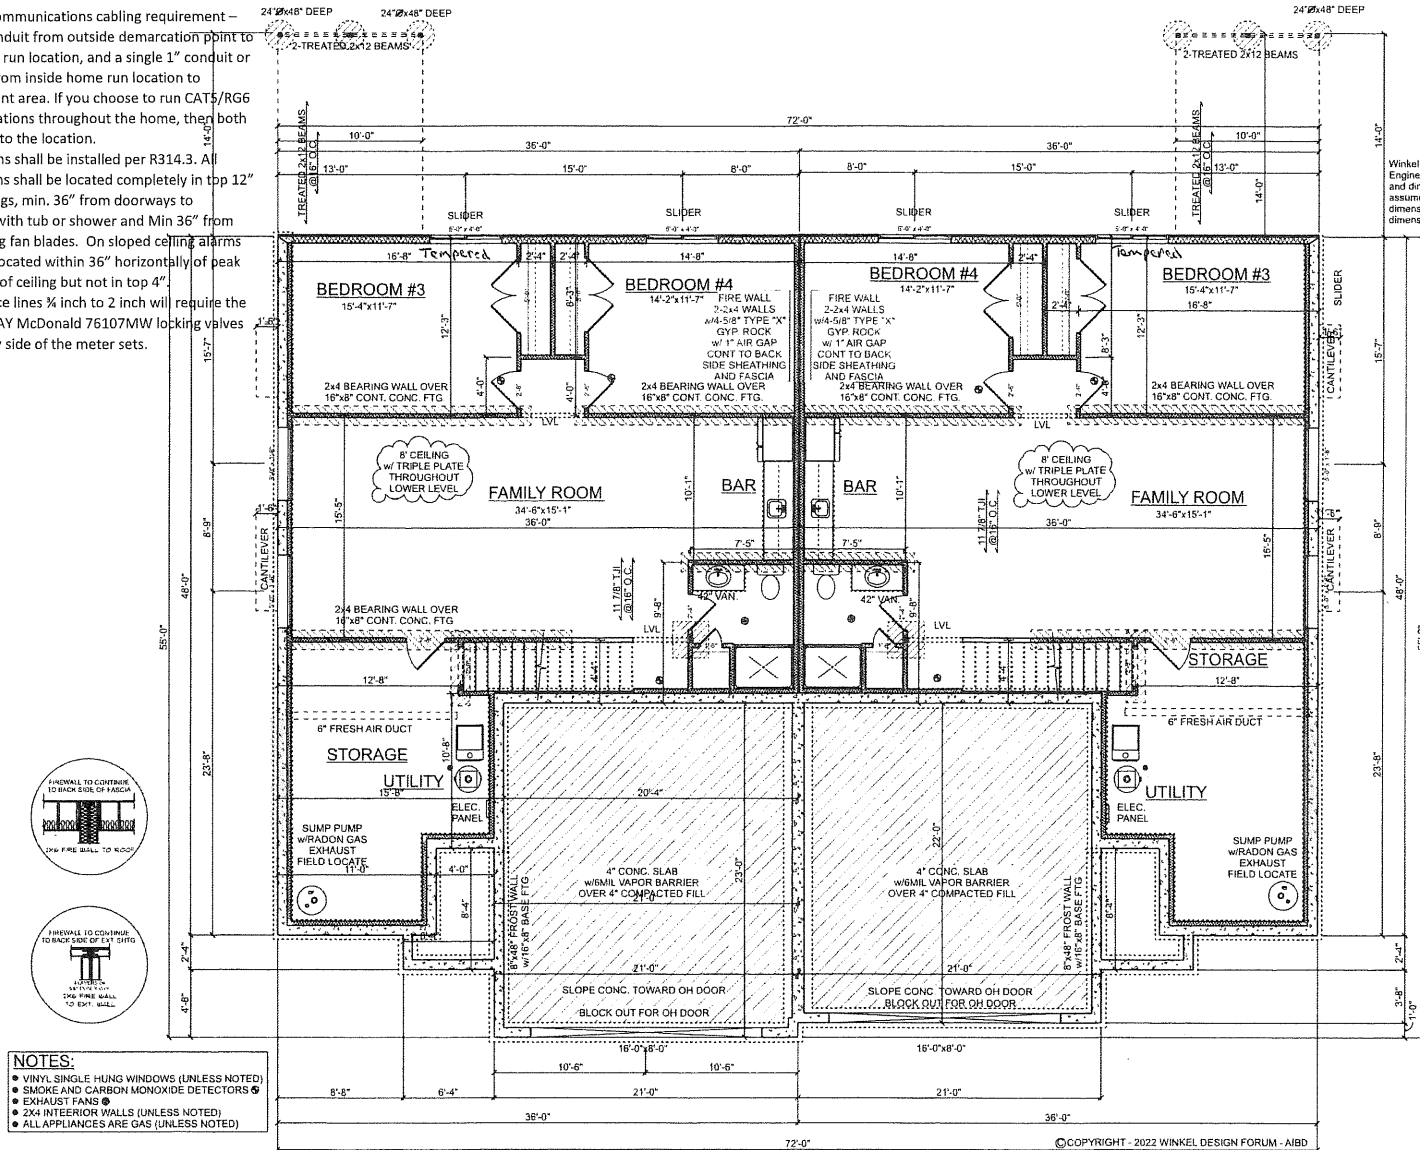

A-1364

Winkel Design Forum is not an Architect or Engineering firm. These plans are conceptual and dimensional only. The General Contractor assumes responsibility for the final layout and dimensions before construction. Verify all dimensions before construction.



WINKEL DESIGN FORUM
Professional Design Services
2885 Brandon Ct
Mankato, MN 56002
Phone: 507-210-7762
www.designforum@gmail.com



Name: Duplex A-1364 No VW
Contr: Scallion Custom Homes
Scale: 1/8" = 1'-0" Date: 9-16-2022

Sheet
3 OF 4